


KIOSK No.6.

Arrangement of Equipment for Postpayment Call
Office using Box C.C. No.16 complete and Telephone
No.196 minus cord.
Magneto System.

| Drawn | Checked | Approved | Date | SUFFIX | |
|---|---------|-------------|---------|--------|---|
| Aze | T.G.M. | [Signature] | 23/1/35 | | A |
| Amendment | | | | | |
| Box Batt. Lec. WK4 2 Cell C.O was Box Batt. for 3 Dry Cells | | | | 6.5.36 | |
| | | | | | |
| | | | | | |

Scale. 1/8

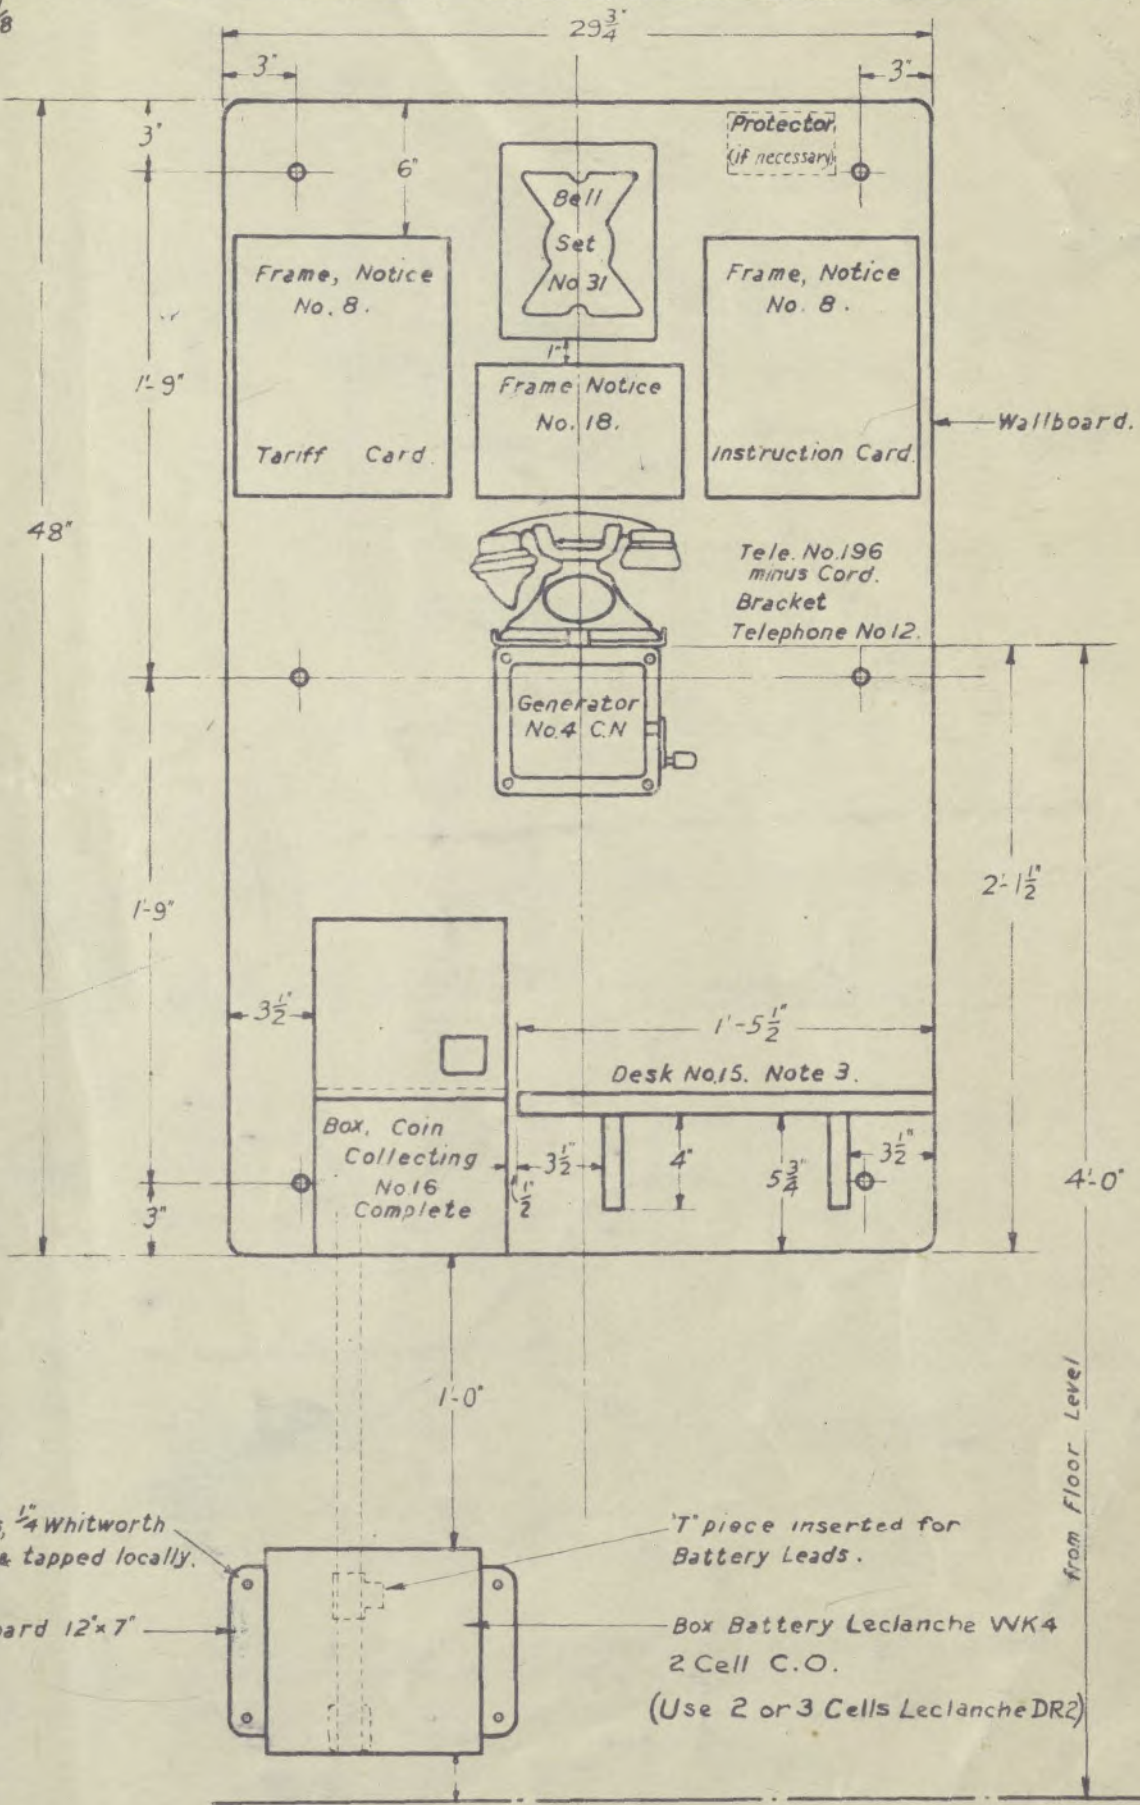

NOTES:-

1. No wiring to appear on face of Wallboard.
2. Two battens 3' 9" x 3" x 1" should be screwed to the bosses on the back panel and the Wallboard 48" x 29 3/4" secured thereto so that the bottom edge of Bracket Telephone No.12 is 4'-0" from floor level.
3. The directory should lie flat on Desk No.15; The cord should be passed through hole in desk and fastened to desk bracket.
4. The Tariff, Instruction and Notice Cards will be supplied by the Controller, L.T.S. or District Manager.